


**1 SANITARY & VENT ENLARGED PLAN**  
SCALE: 1/4" = 1'-0"

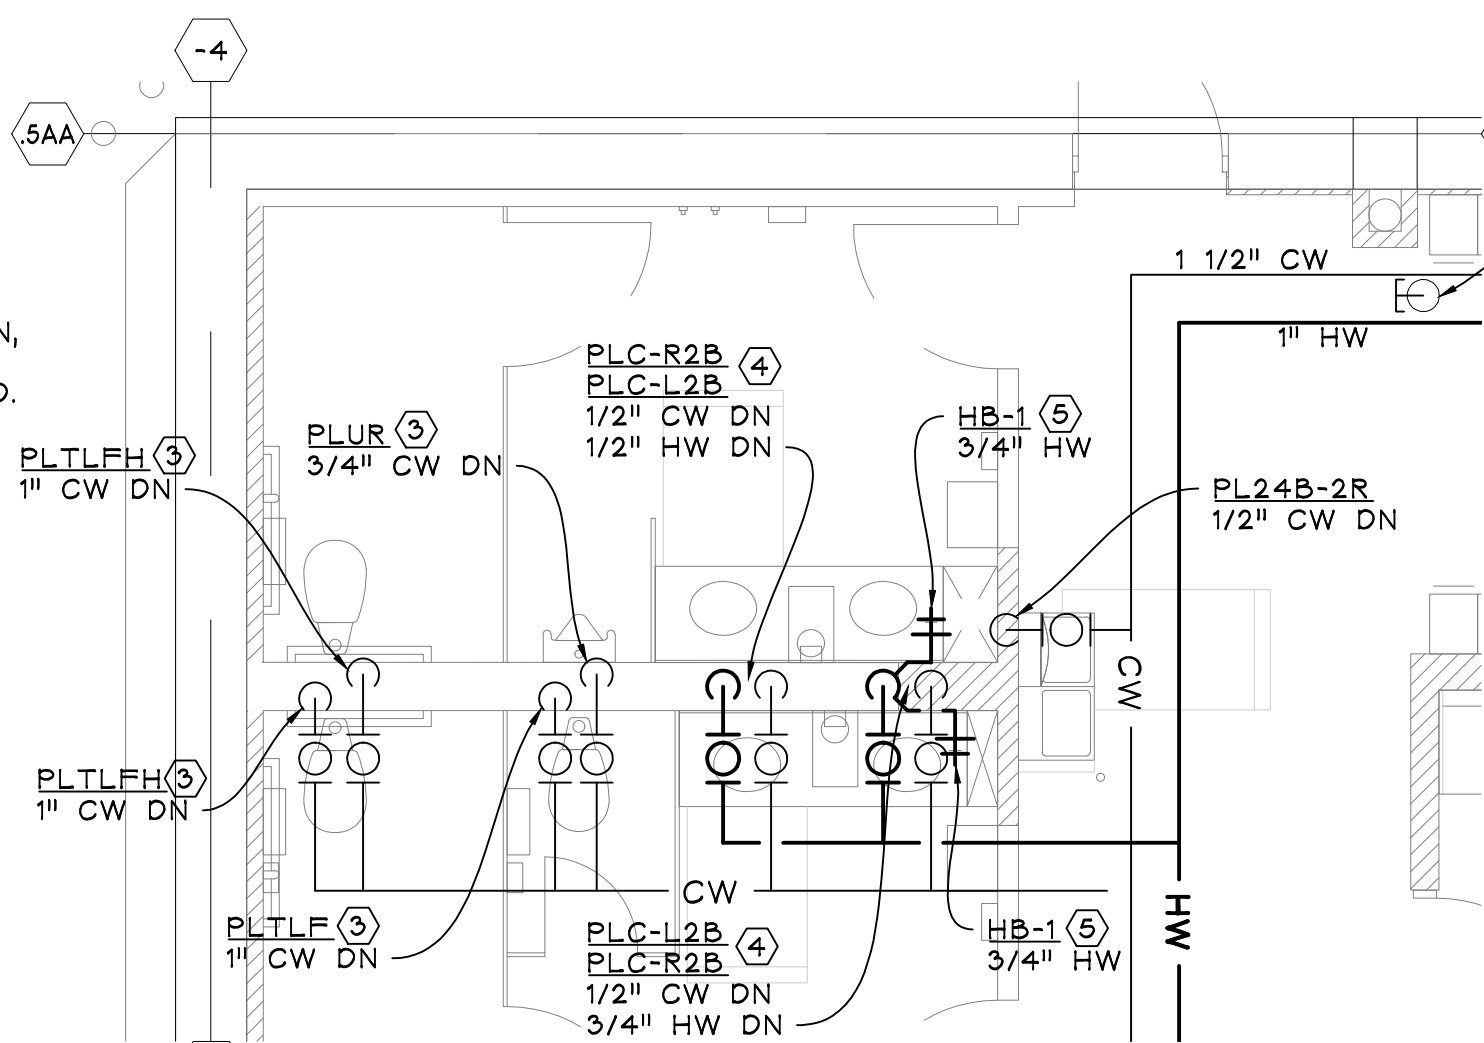


**2 DOMESTIC WATER ENLARGED PLAN**  
SCALE: 1/4" = 1'-0"

### PLUMBING GENERAL NOTES:


1. REFER TO NOTES ON SHEET P01.
2. PROVIDE NEW PLUMBING SERVICES TO FIXTURES AS INDICATED ON PLUMBING FIXTURE SCHEDULE (RE: P6.1).
3. ALL WATER PIPING IN OPEN CEILING TO BE ROUTED TIGHT TO CEILING STRUCTURE.

### KEYED NOTES:


1. PROVIDE NEW HUB DRAIN PER PSD-1 (RE: P5.1). PROVIDE 3" HUB DRAIN UNLESS OTHERWISE NOTED ON DRAWING.
2. ROUTE CONDENSATE PIPING FOR FREEZER OR COOLER INDOOR COIL UNITS THROUGH WALL AND SPILL INTO HUB DRAIN WITH 2" AIR GAP.
3. INSTALL NEW TOILET ROOM FIXTURES. PROVIDE NEW SANITARY AND CW SUPPLY CONNECTIONS.
4. INSTALL NEW COUNTERTOP SINKS PER PSD-50 (RE: P5.2). PROVIDE NEW SANITARY AND WATER SUPPLY CONNECTIONS. SEE SPECIFICATION 22 42 00 SECTION 2.3 "CONTRACTOR PROVIDED PLUMBING FIXTURES" FOR ACCEPTABLE MANUFACTURERS. PROVIDE ACCESSIBLE FIXTURES WITH HARD WIRED TOUCHLESS FAUCETS. PROVIDE THERMOSTATIC MIXING VALVES SET TO 105 DEG F.
5. MOUNT NEW HOSE BIBB 18" AFF.
6. PROVIDE NEW LIGHT DUTY FLOOR DRAIN FOR FINISHED FLOOR PER PSD-3 (RE: P5.1).
7. MOUNT NEW HOSE BIBB 18" AFF. CONNECT 3/4" HOSE TO PROPORTIONER.
8. INSTALL EYEWASH WITH MIXING VALVE PER ASSE 1070.
9. PROVIDE NEW HEAVY DUTY FLOOR DRAIN FOR FINISHED FLOOR PER PSD-2 (RE: P5.1).
10. PROVIDE NEW TRENCH DRAIN PER PSD-34 (RE: P5.2). TD1-X WHERE X IS THE LENGTH OF THE TRENCH DRAIN IN FEET.
11. INSTALL 1-COMP SINK PER PSD-5A (RE: P5.1). ROUTE 1 1/2" INDIRECT DRAIN TO NEW FLOOR SINK. INSTALL FLOOR SINK PER PSD-16B (RE: 6.2).
12. INSTALL HAND SINK WITH FITTINGS AS REQUIRED. PROVIDE 1 1/2" DRAIN TO SAN UP AND V DN. ROUTE VENT TO NEAREST EXISTING VENT THROUGH ROOF. PROVIDE THERMOSTATIC MIXING VALVE SET TO 105 DEG F.
13. INSTALL 3-COMP UTENSIL SINK PER PSD-7 (RE: P5.1). ROUTE 1 1/2" INDIRECT DRAINS FROM EACH COMP TO NEW FLOOR SINK. INSTALL FLOOR SINK PER PSD-16B (RE: 6.2).
14. PROVIDE 3/4" CW DN TO FILTER. ROUTE FW TO OVEN. ROUTE PLUMBING AND DRAINAGE FOR OVEN PER PISD-2 & PSD-23 (RE: P5.1 & P5.2).
15. PROVIDE 3/4" CW DN TO FILTER. ROUTE FW TO OVENS. ROUTE PLUMBING AND DRAINAGE FOR OVENS PER PISD-2 & PSD-23A (RE: P5.1 & P5.2).

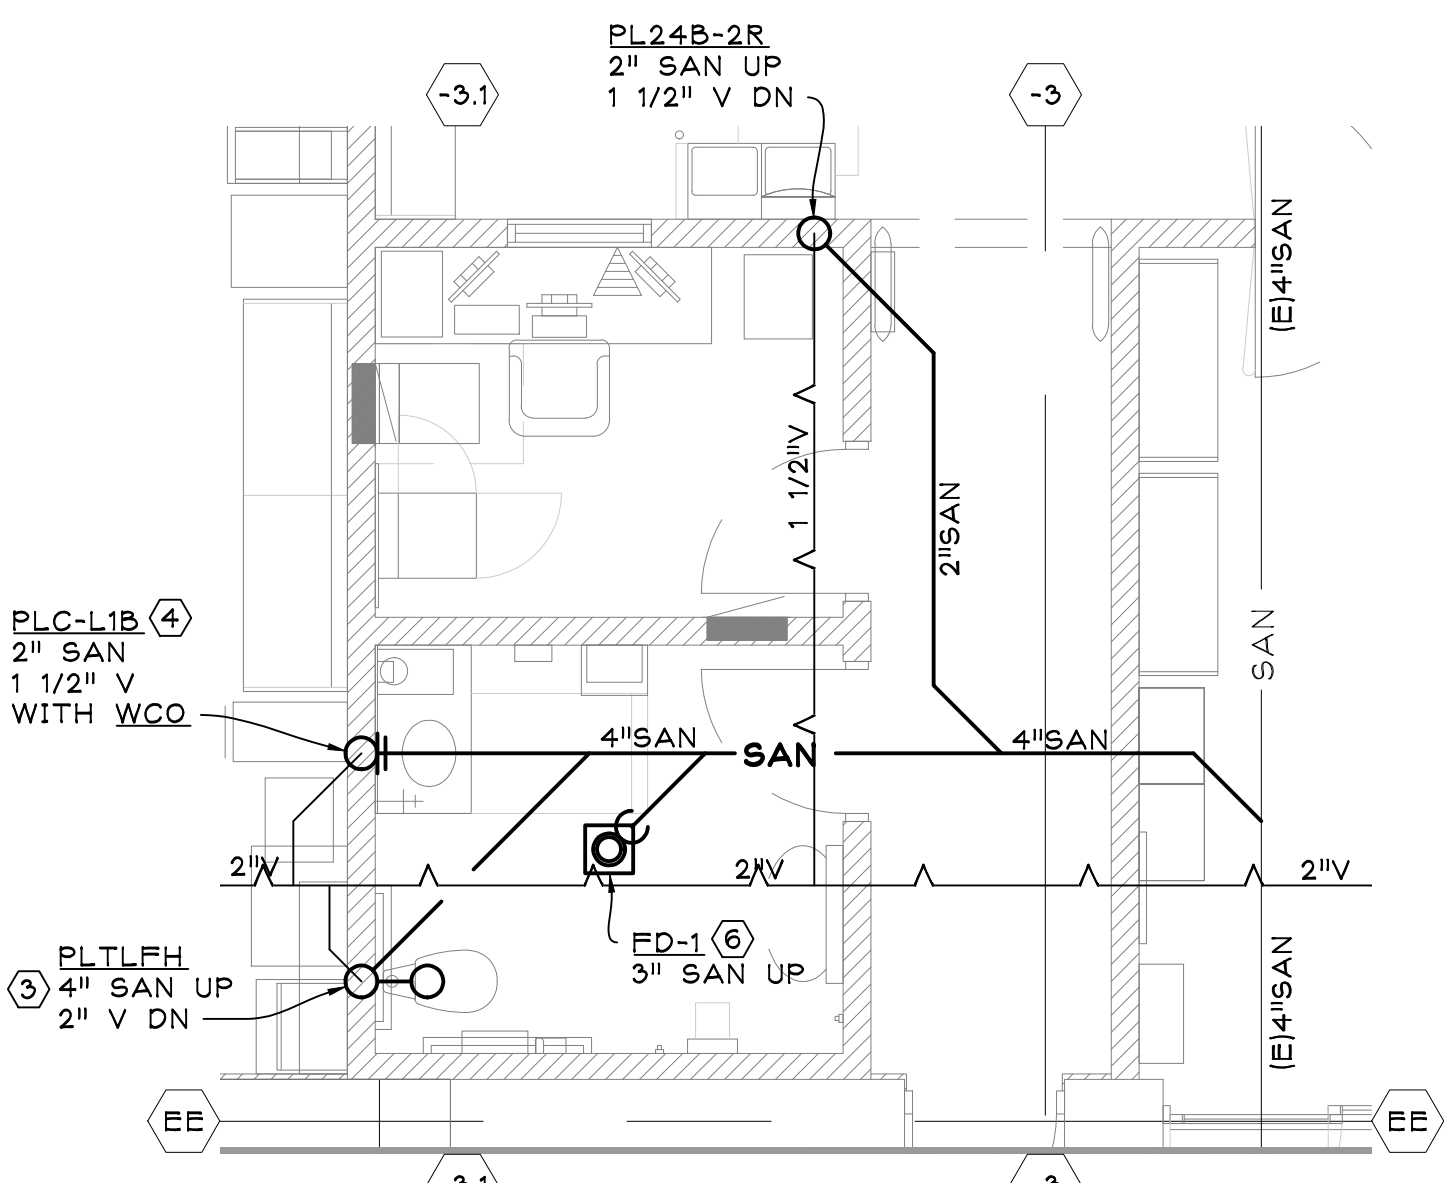


**3 SANITARY & VENT ENLARGED PLAN**  
SCALE: 1/4" = 1'-0"

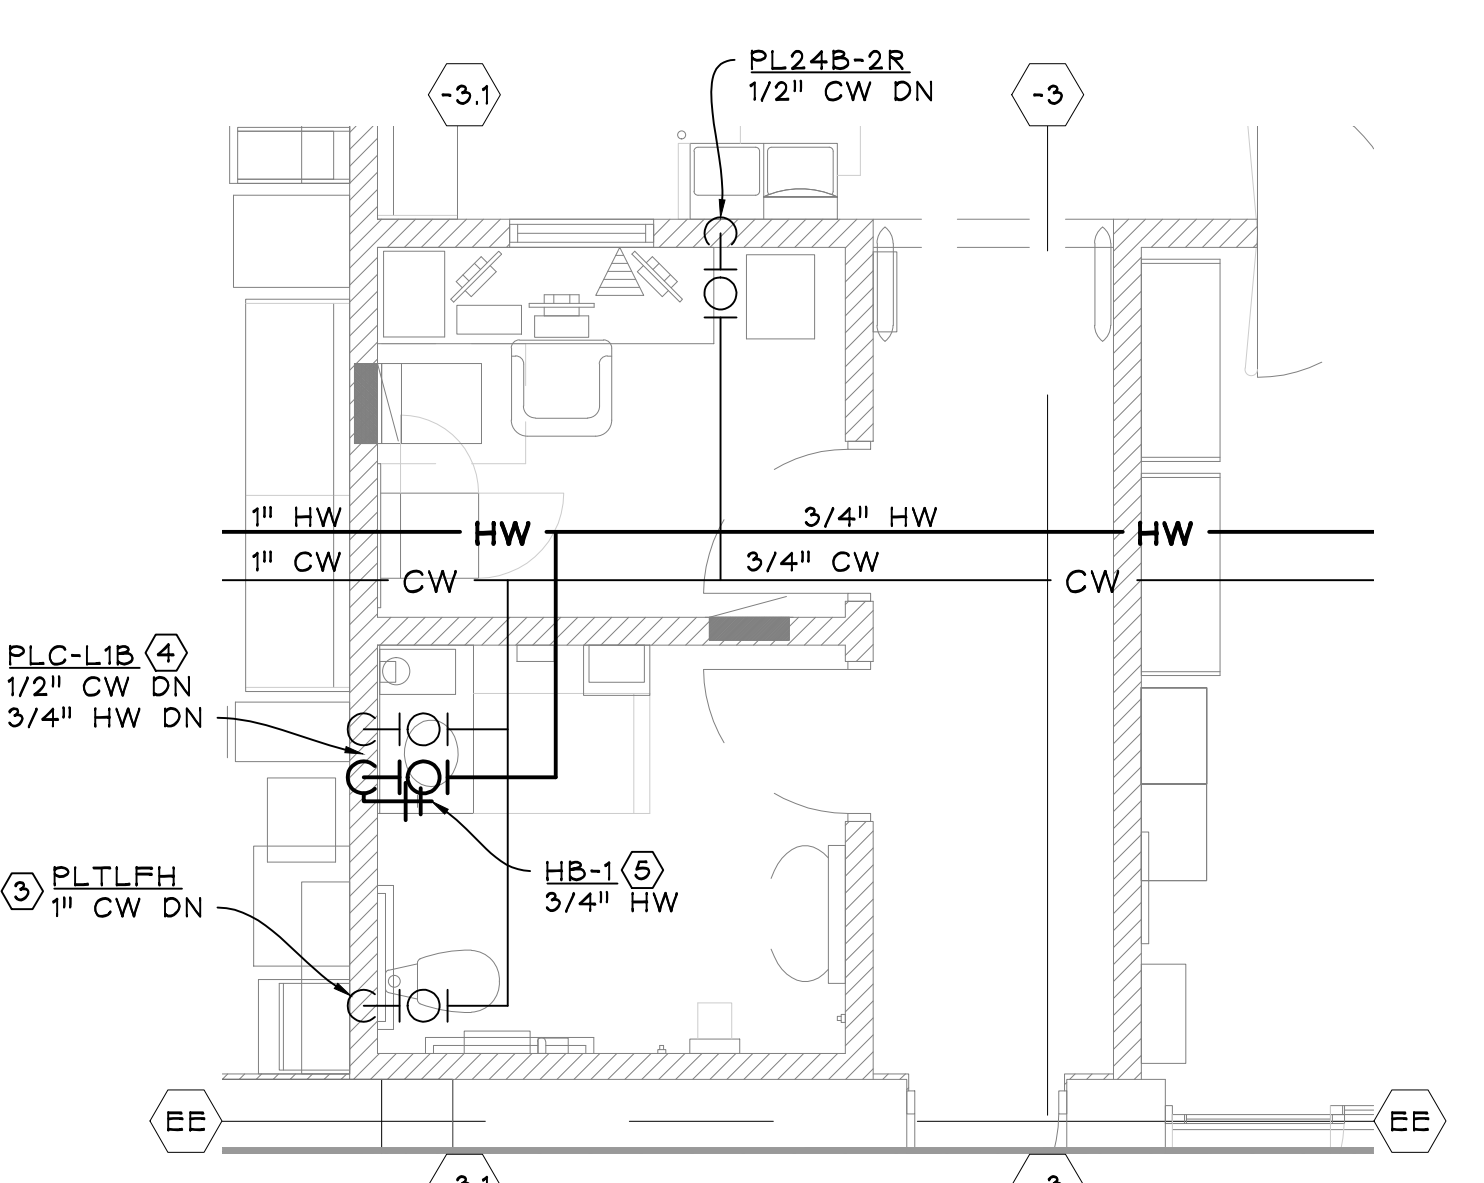


**4 DOMESTIC WATER ENLARGED PLAN**  
SCALE: 1/4" = 1'-0"

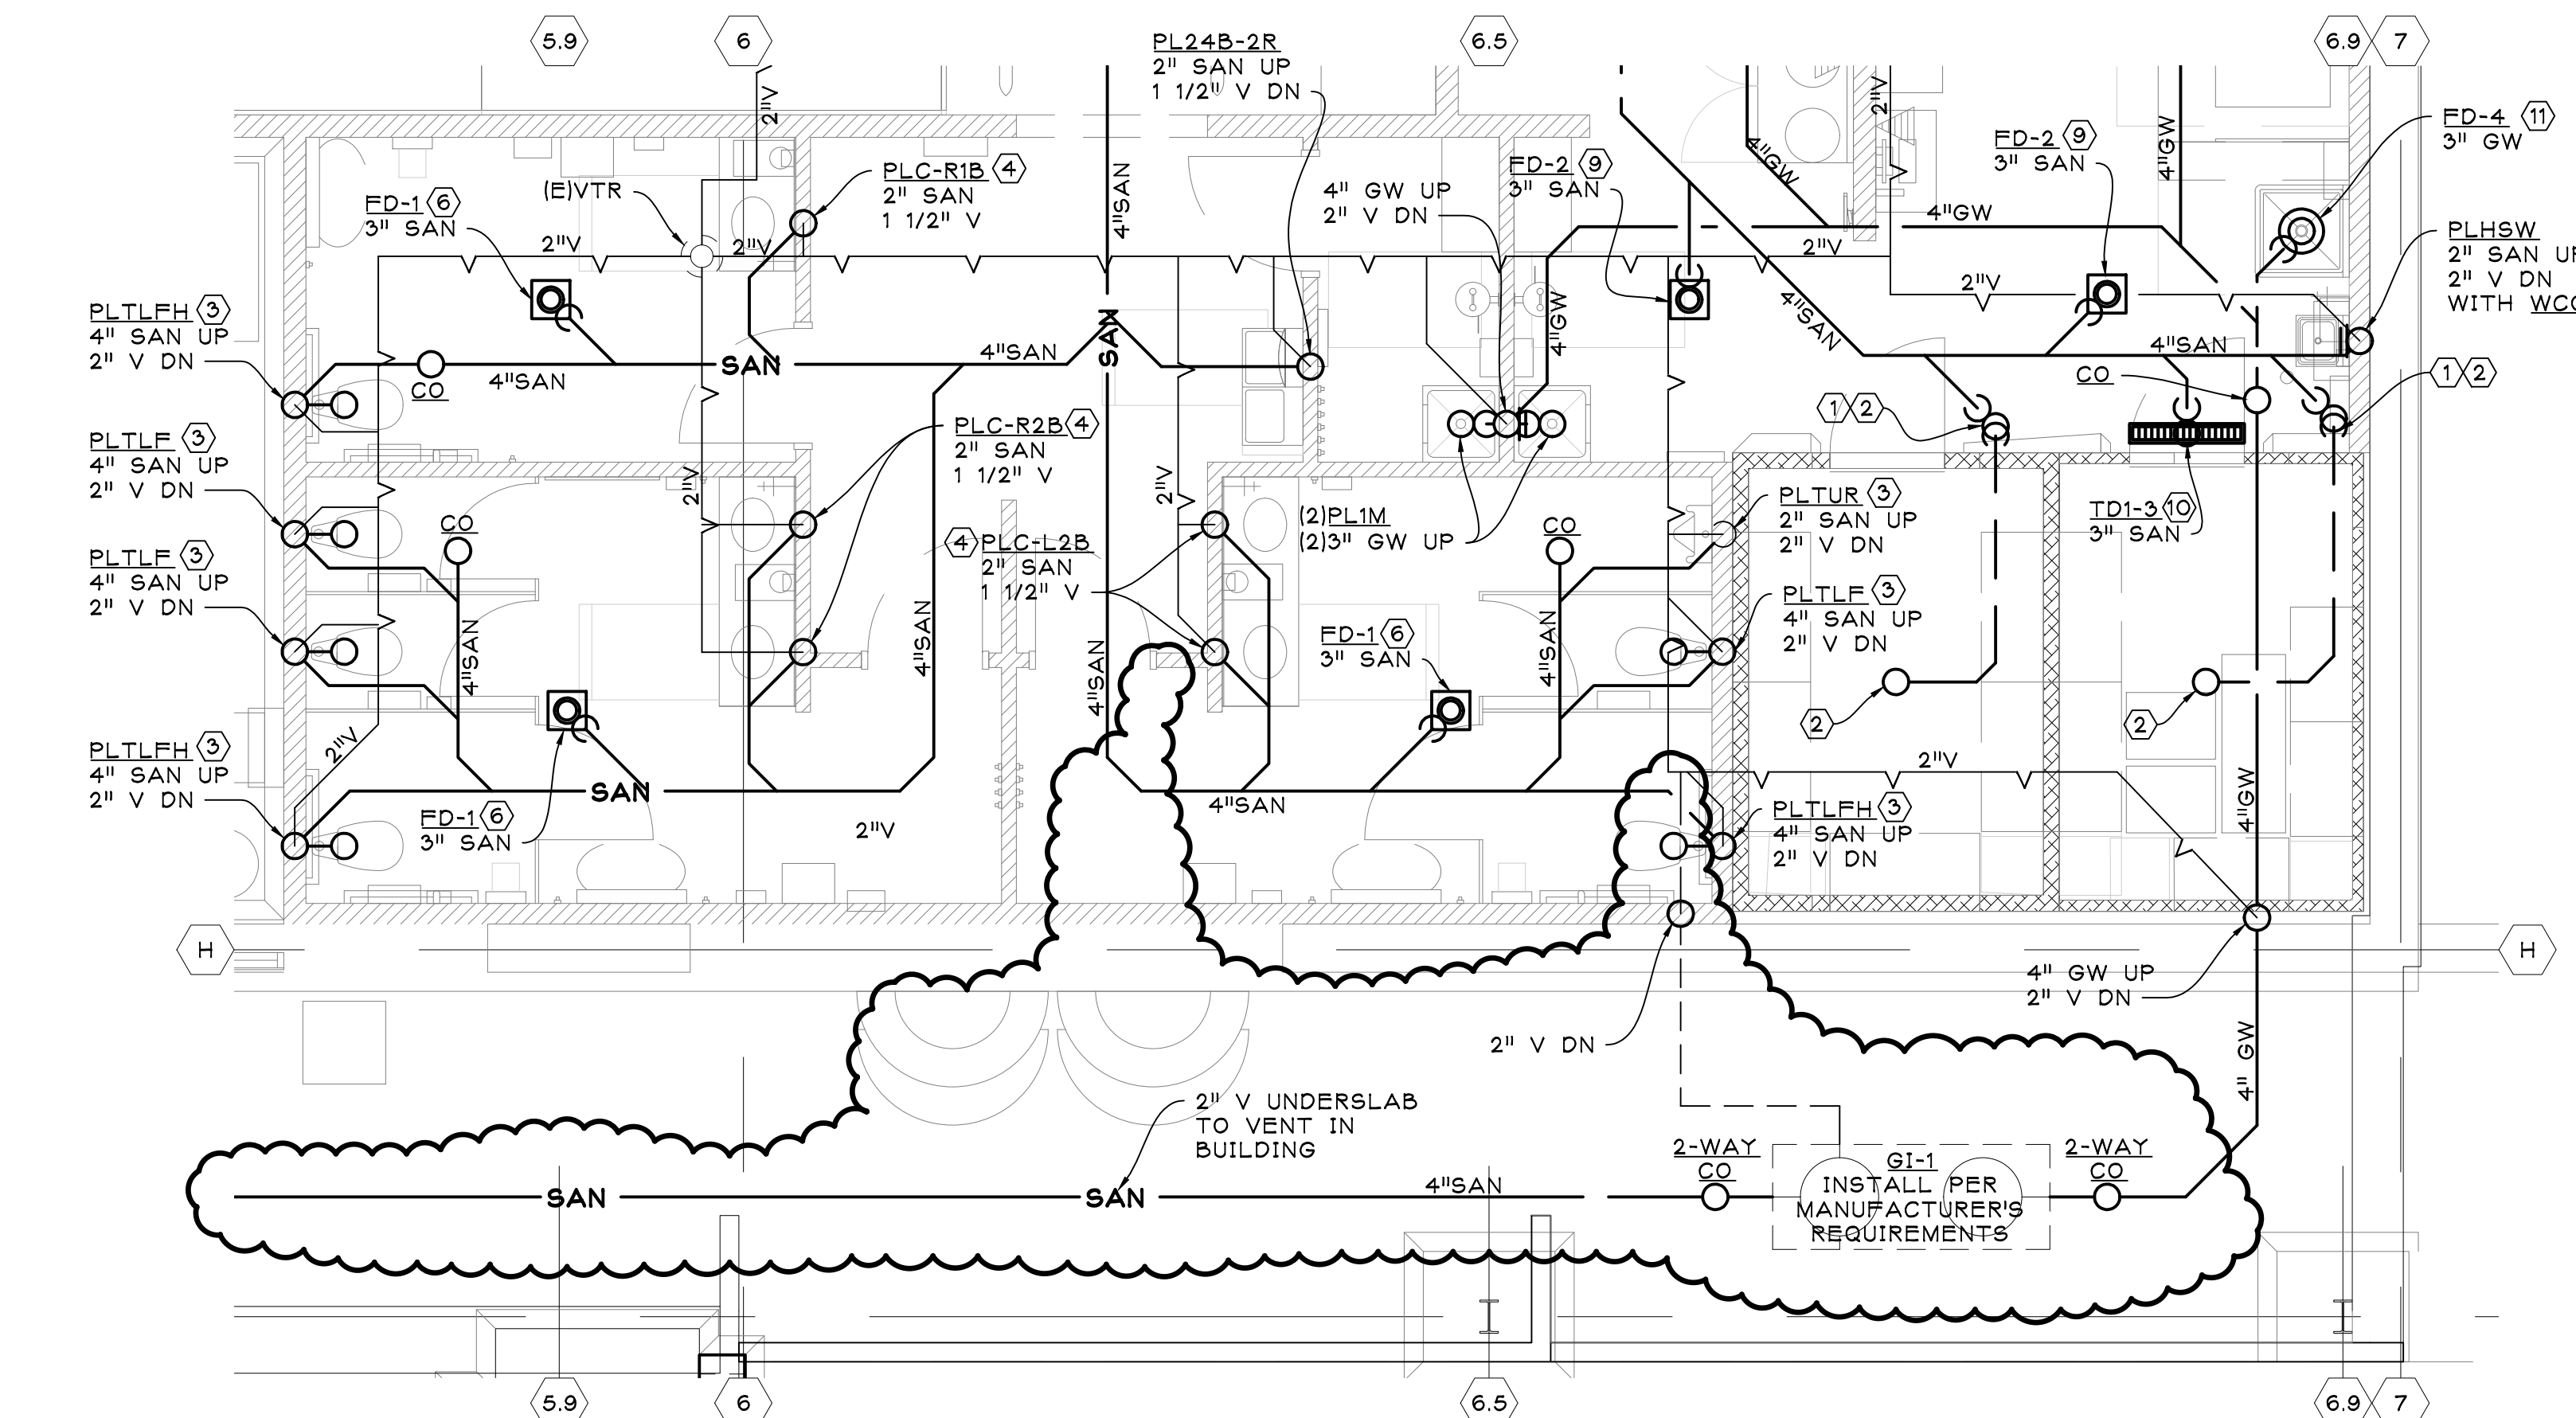


**5 SANITARY & VENT ENLARGED PLAN**  
SCALE: 1/4" = 1'-0"

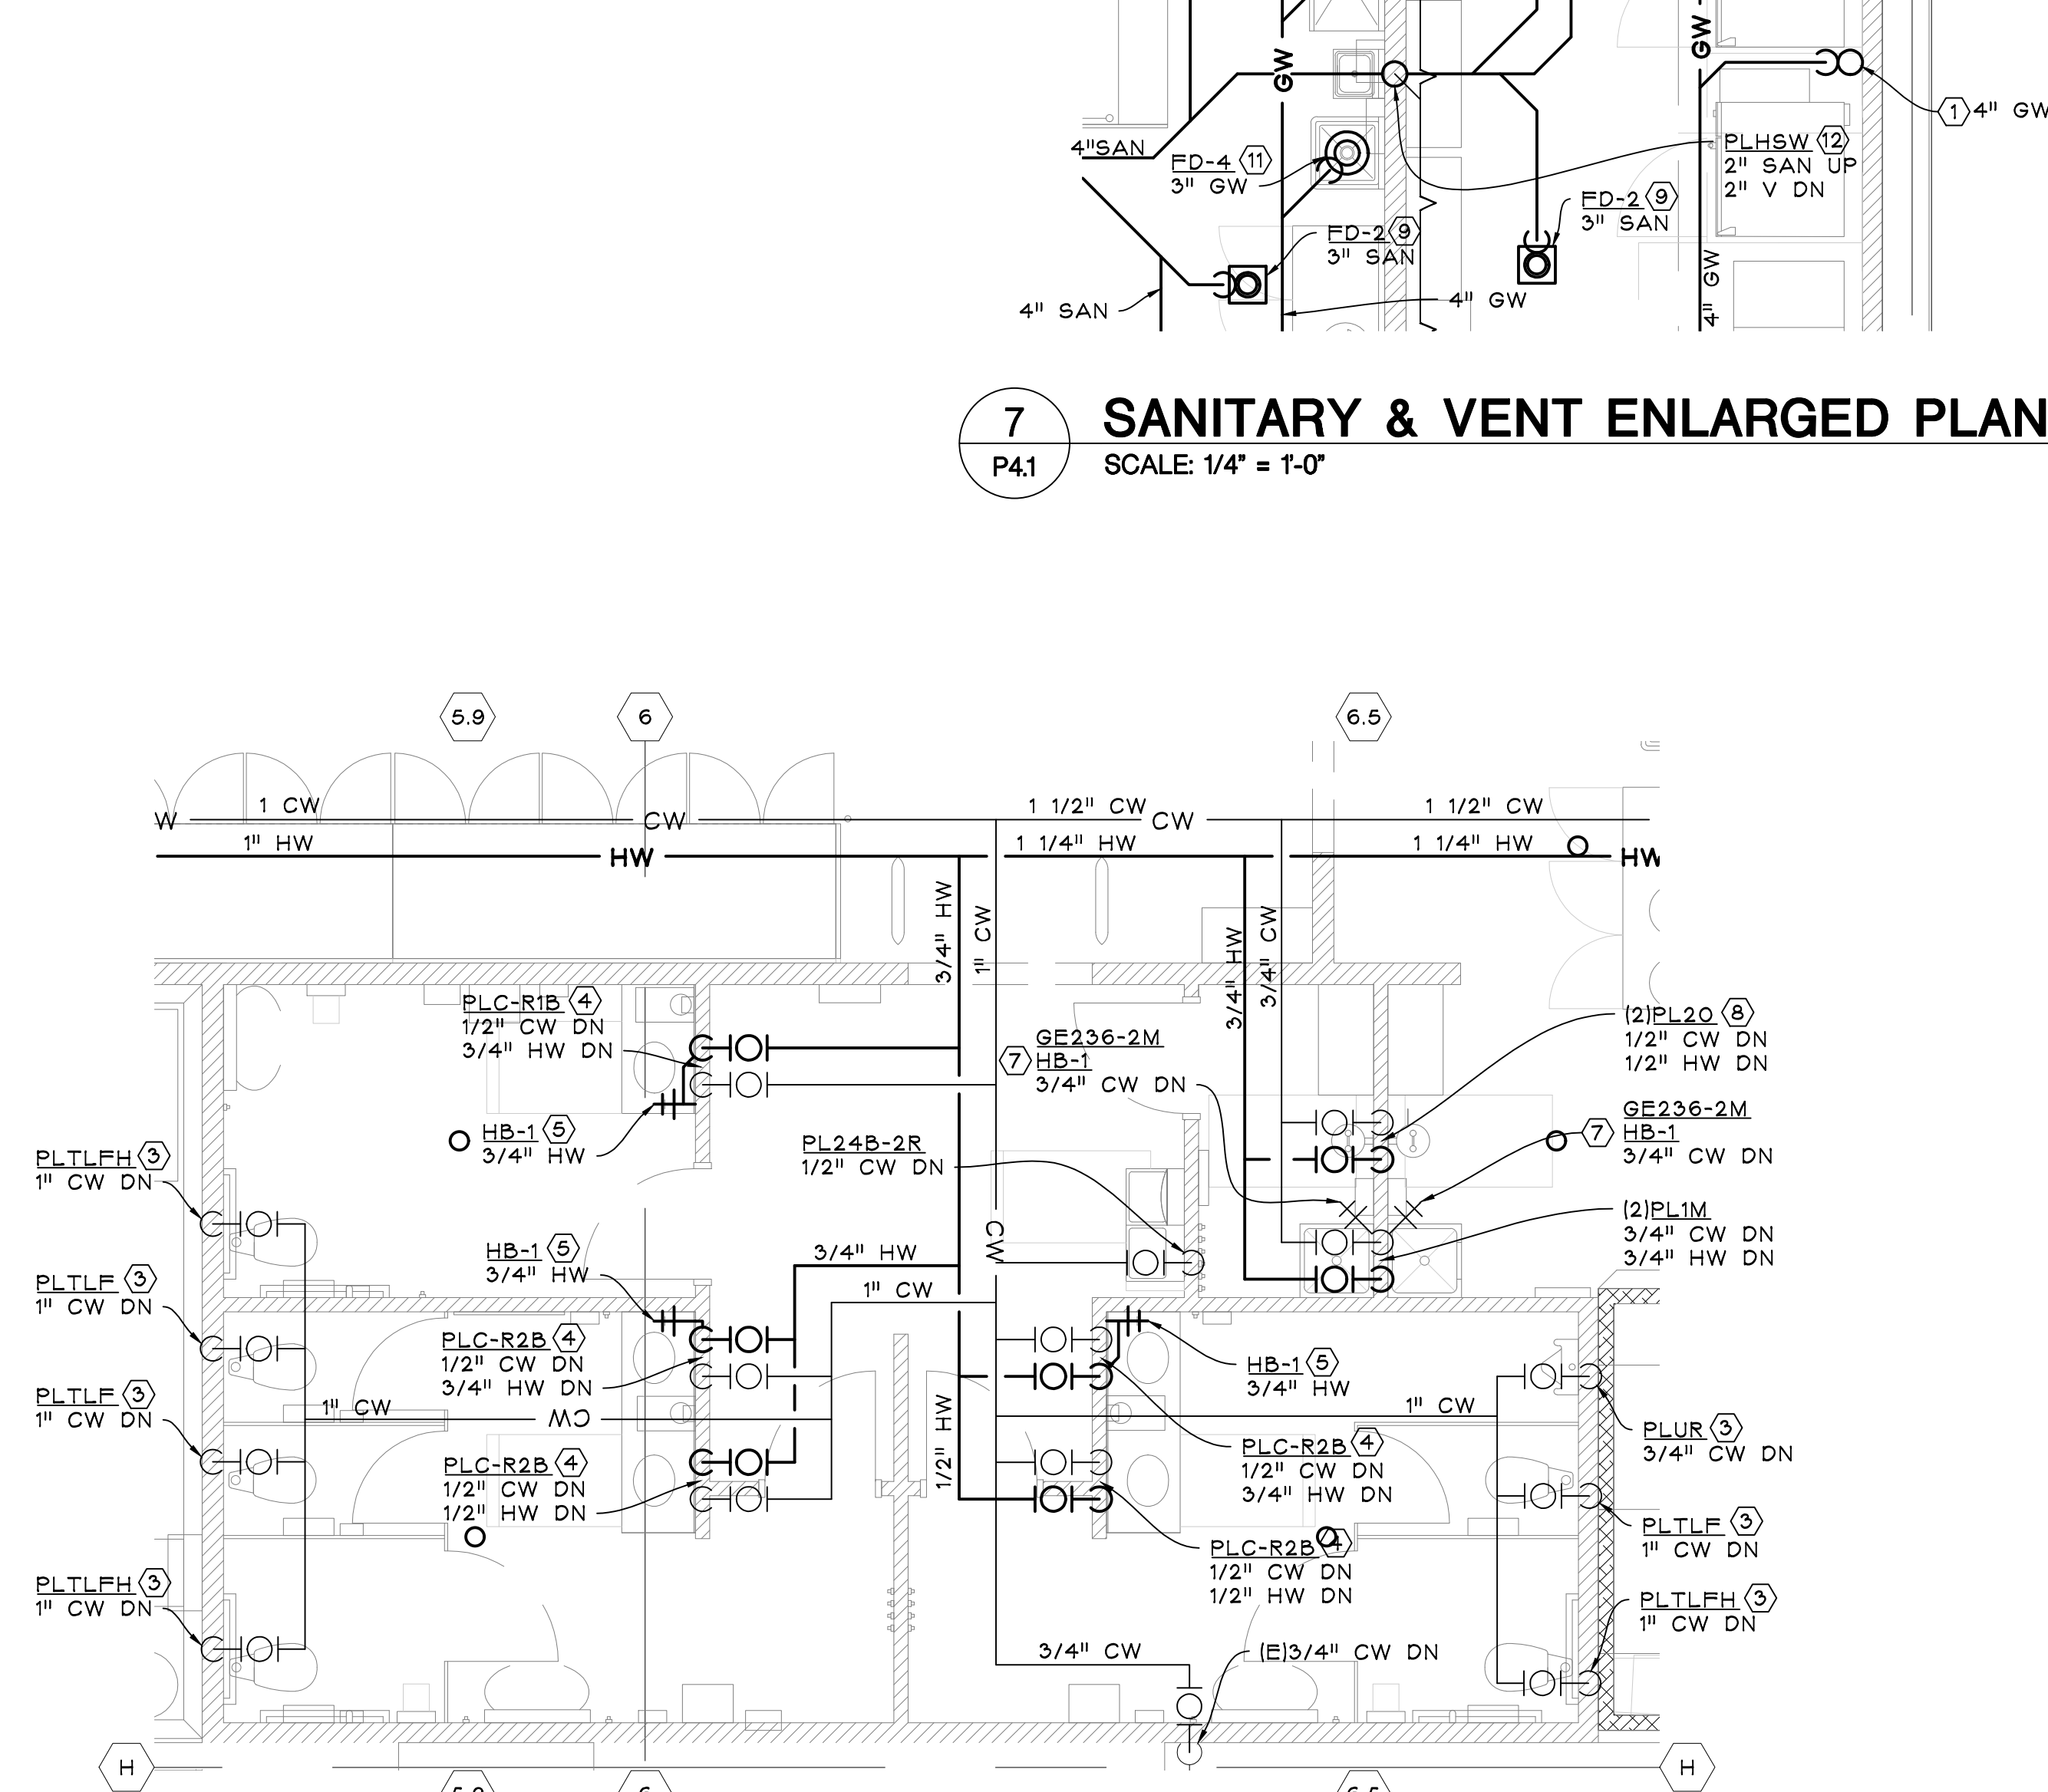

**7 SANITARY & VENT ENLARGED PLAN**  
SCALE: 1/4" = 1'-0"

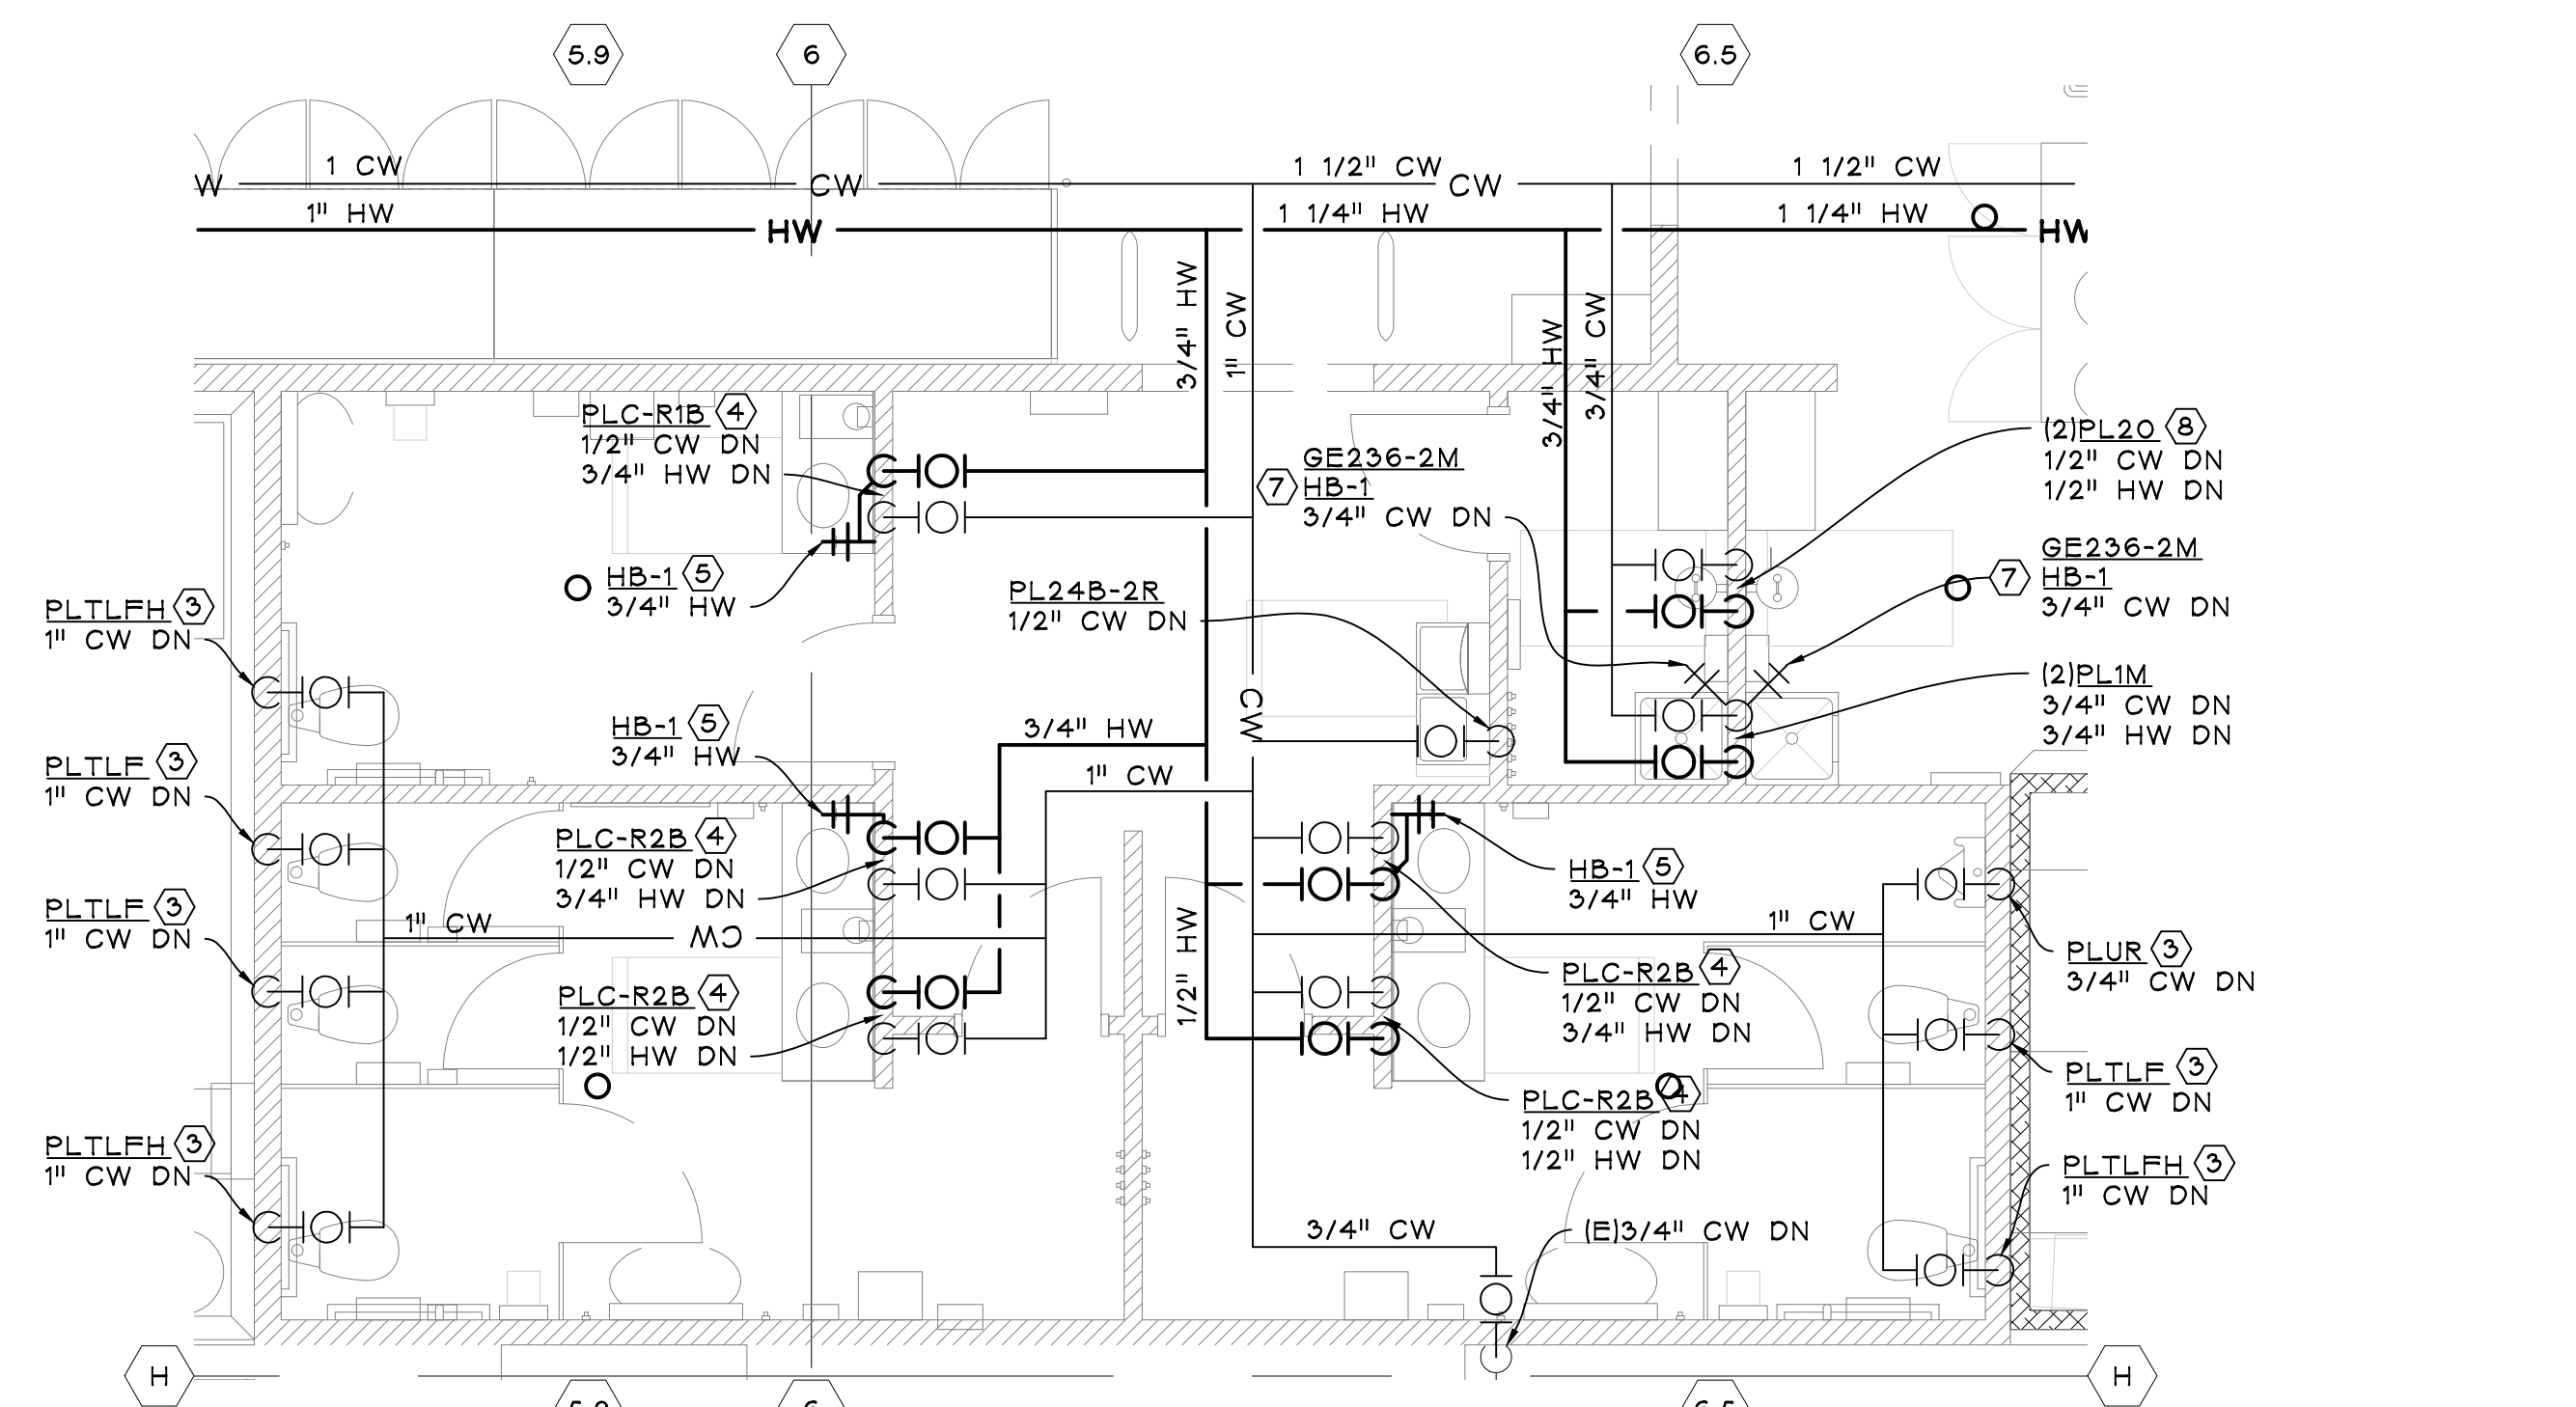

**6 DOMESTIC WATER ENLARGED PLAN**  
SCALE: 1/4" = 1'-0"

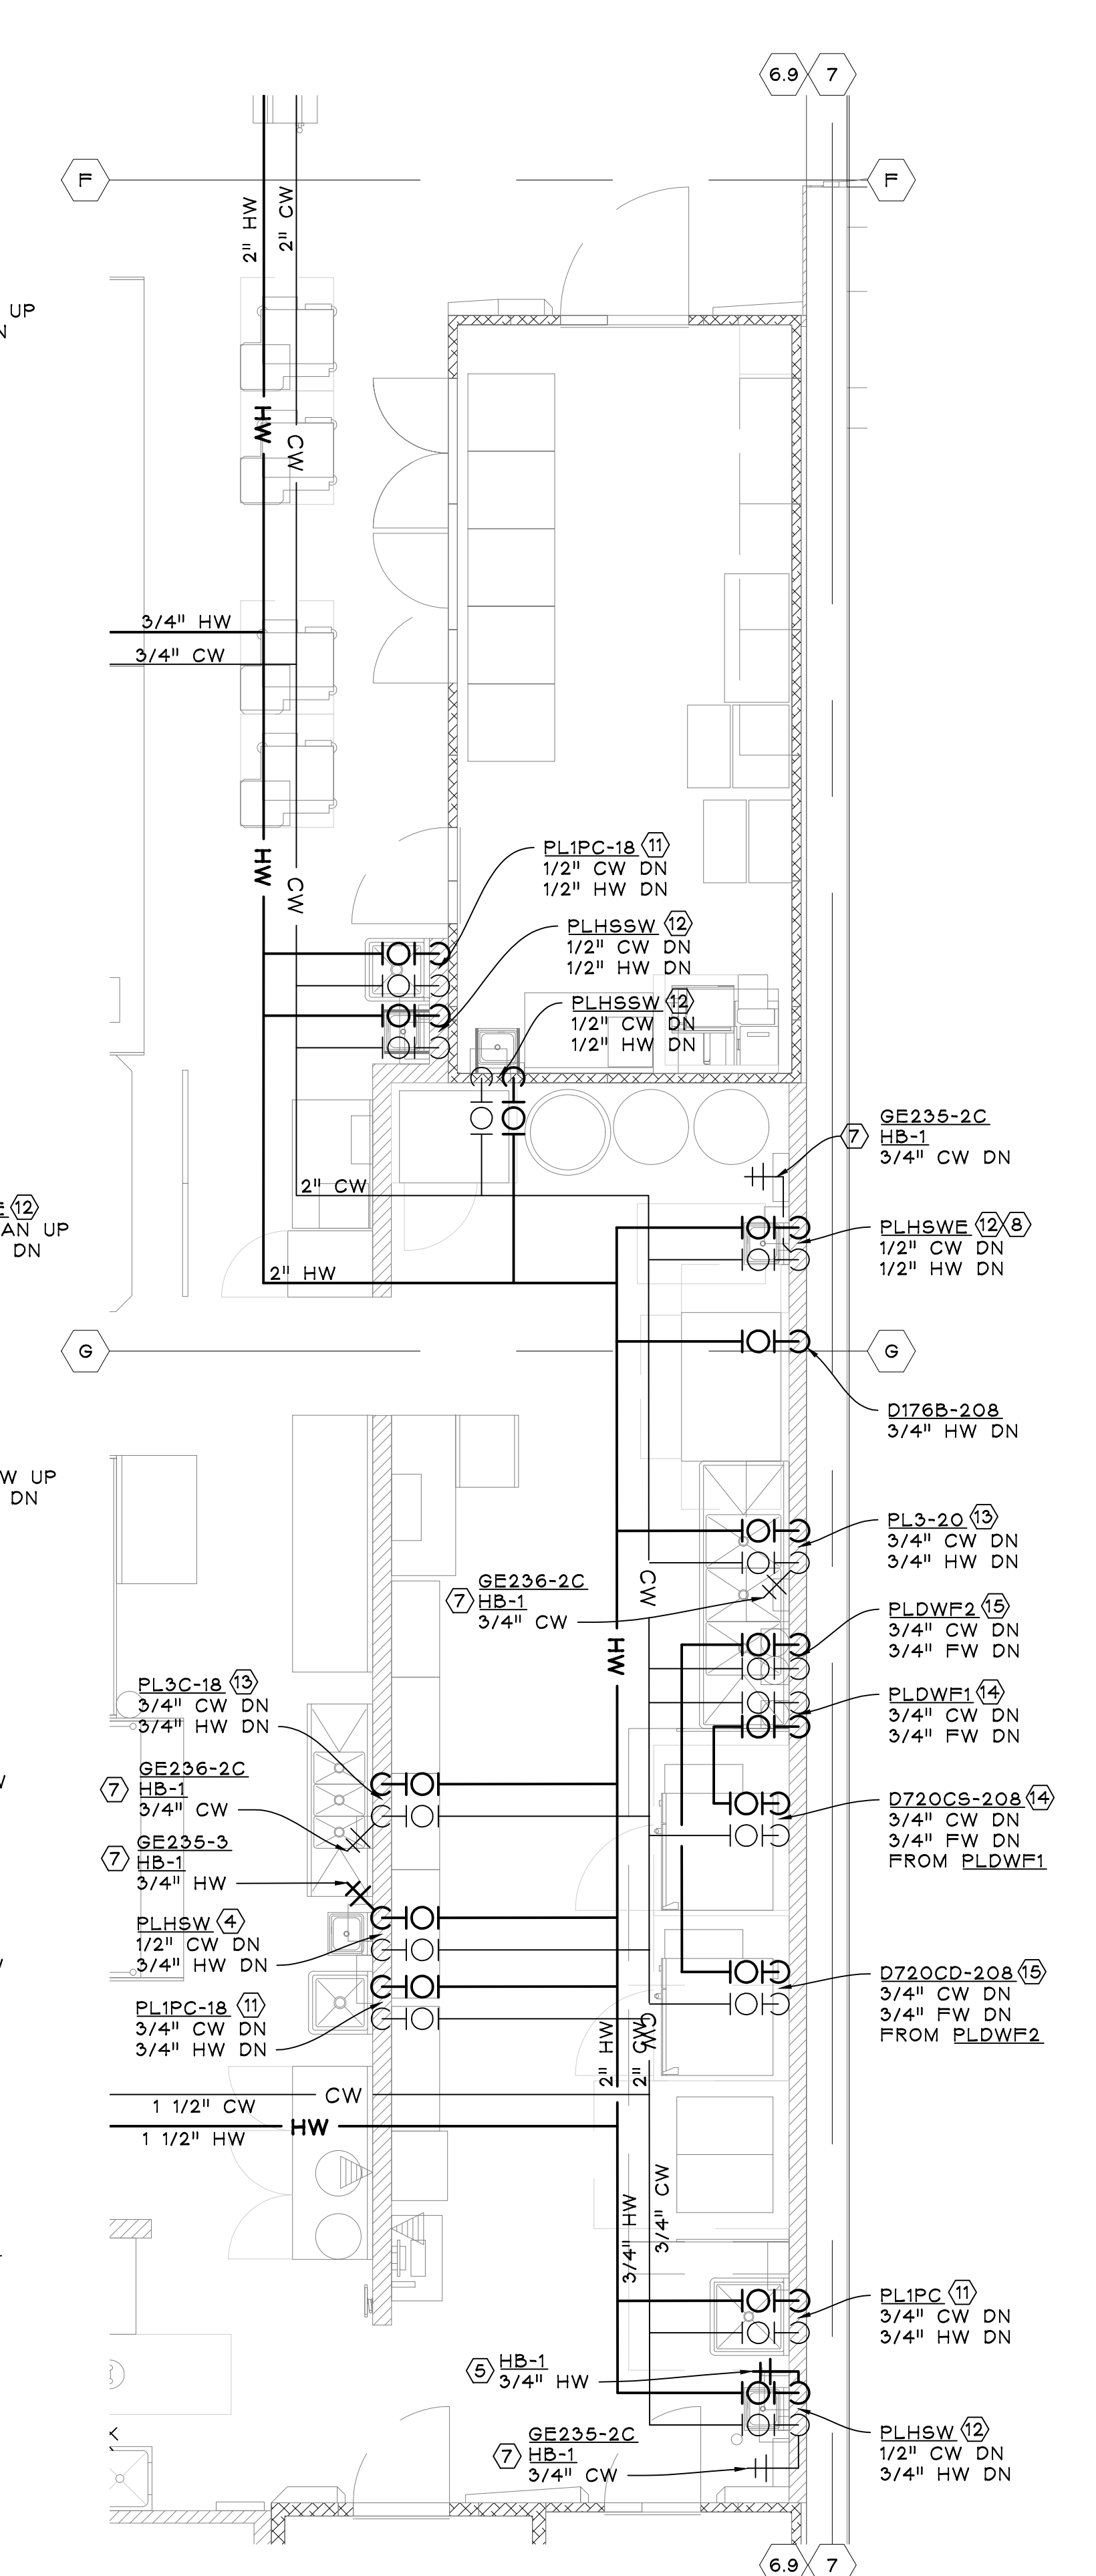

**8 DOMESTIC WATER ENLARGED PLAN**  
SCALE: 1/4" = 1'-0"

BULLETIN NO 2  
BIDS AND PERMITS  
80% OWNER REVIEW  
05/15/2025  
02/11/2026  
12/18/2024

PROPOSED NEW STORE  
TAKEOVER FOR:

**Kroger**

STORE NO. D-416  
15100 SILVER PARKWAY  
FENTON, MI 48430

THE KROGER CO. OF MICHIGAN

**jeffery a. scott**  
architects p.c.

32316 grand river ave. suite 200  
farmington, michigan 48336-3261  
(248) 476-8800 fax (248) 476-8833

ENLARGED PLUMBING PLANS

project no. sheet no.

**24108 P4.1**

copyright © 2025