



**33**  
E13  
**PARTIAL ELECTRICAL POWER PLAN**  
SCALE: 1/4" = 1'-0"

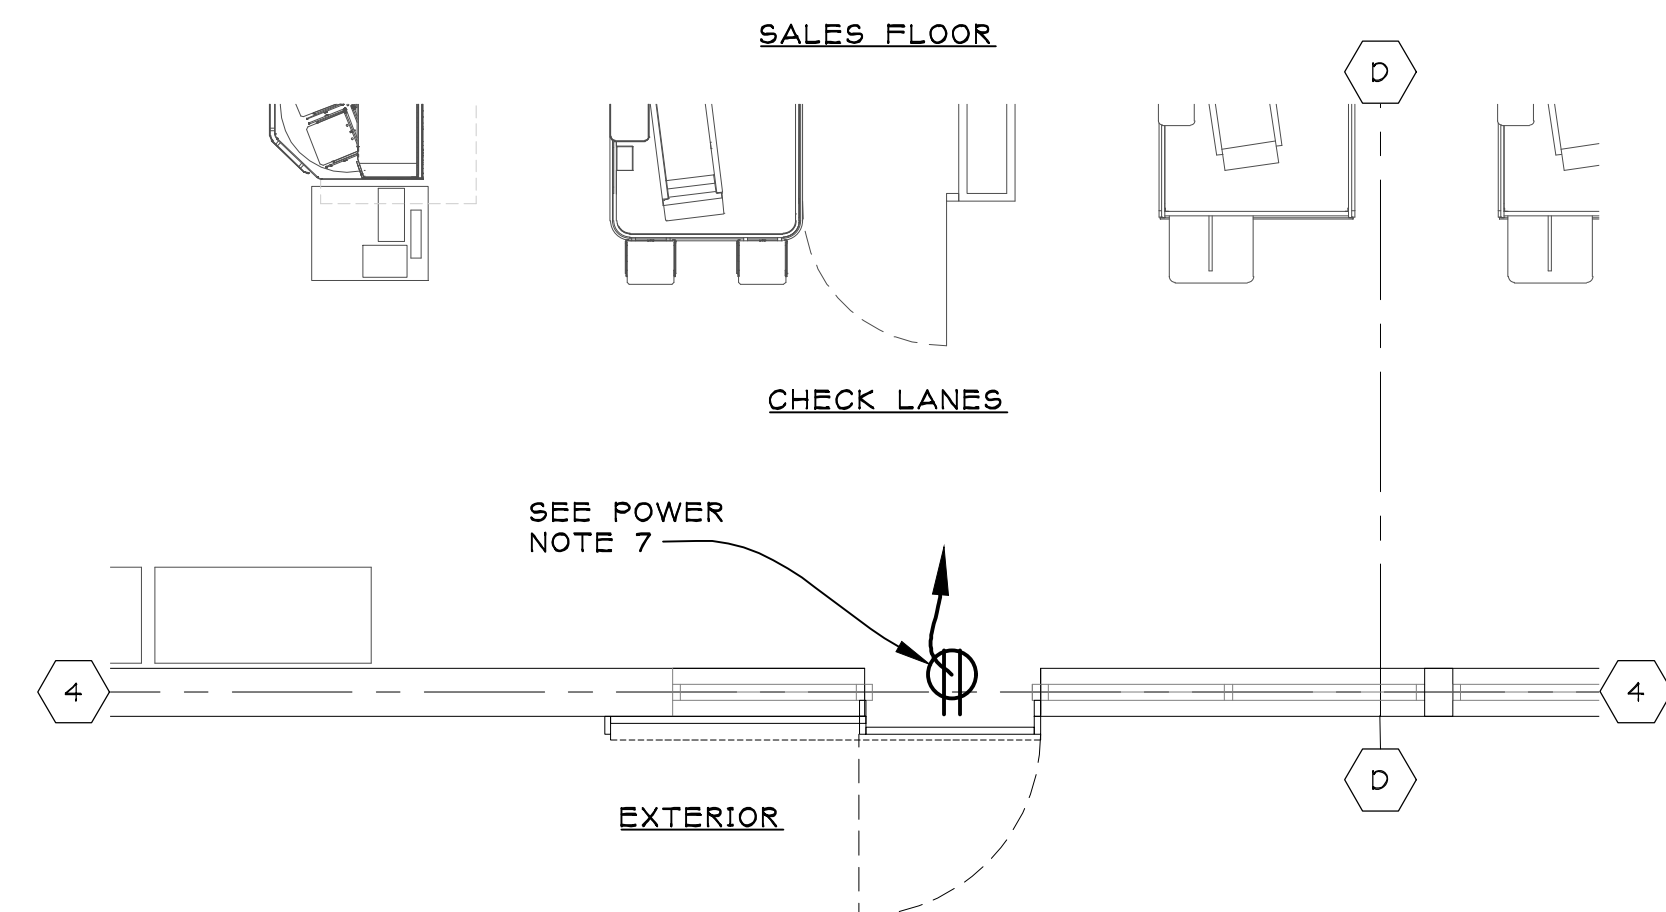

**32**  
E13  
**PARTIAL ELECTRICAL POWER PLAN**  
SCALE: 1/4" = 1'-0"

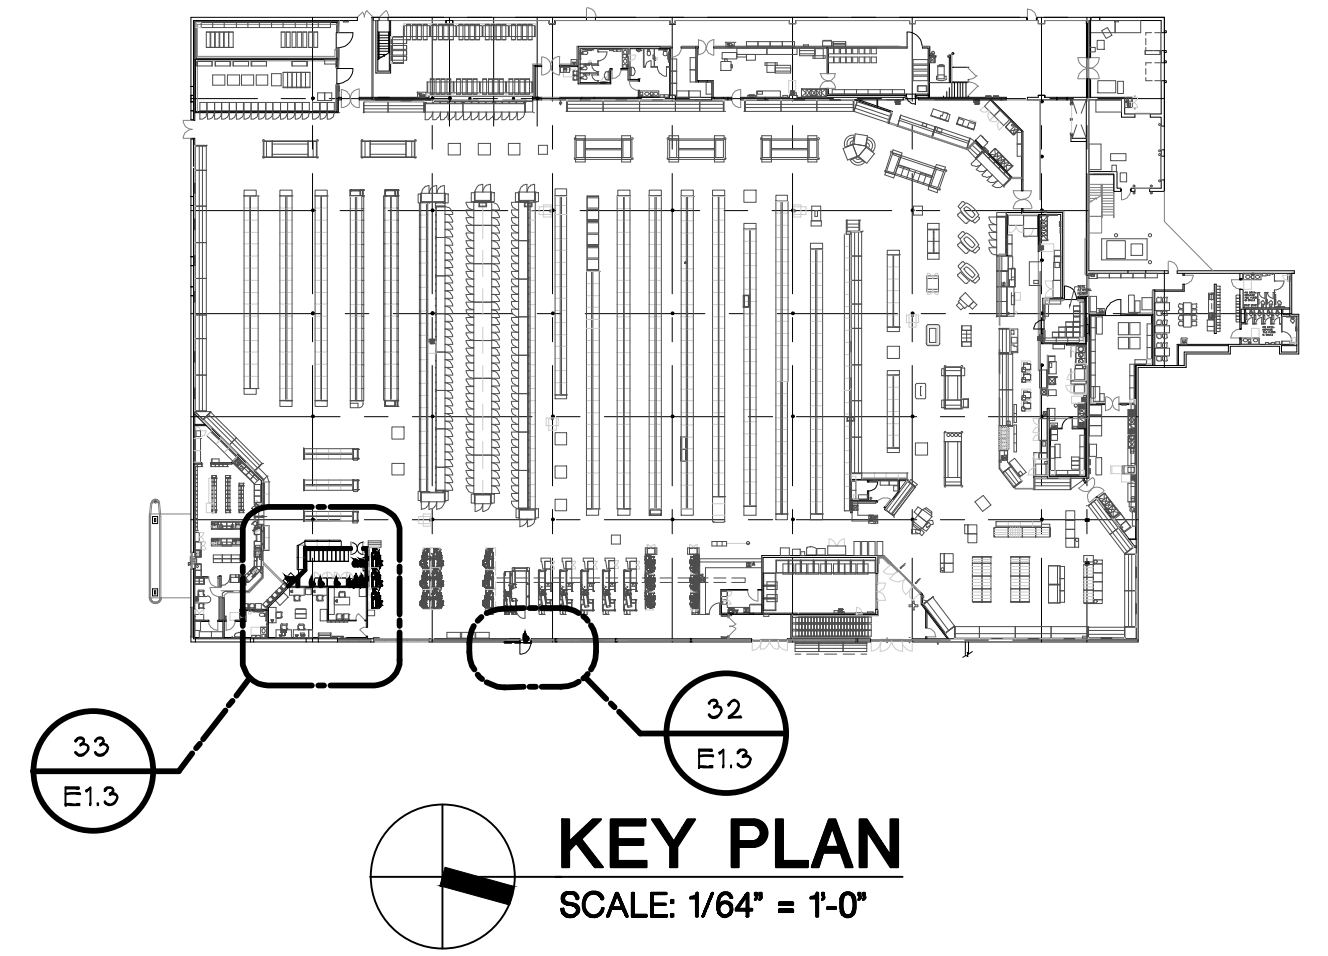

### ELECTRICAL LIGHTING NOTES:

1. REUSE EXISTING BRANCH CIRCUITS MADE AVAILABLE BY DEMOLITION WHERE PRACTICAL UNLESS NOTED OTHERWISE. EXTEND EXISTING WIRING METHODS AS REQUIRED TO ACCOMMODATE NEW EQUIPMENT LOCATIONS. PROVIDE ADJUSTMENTS OR ADDITIONAL BRANCH CIRCUITS AS REQUIRED FROM NEAREST SUITABLE PANELBOARD. ROUTE NEW RACEWAYS BY MOST PRACTICAL CONCEALED MEANS AVAILABLE UNLESS NOTED OTHERWISE. DO NOT INSTALL EXPOSED RACEWAYS OR SAWCUT WITHOUT THE CONSENT OF THE KROGER PROJECT MANAGER.
2. UPDATE ALL LABELS AND DIRECTORIES FOR BRANCH CIRCUITS AFFECTED BY NEW CONSTRUCTION. HANDWRITTEN IDENTIFICATION SHALL NOT BE ACCEPTABLE.
3. COORDINATE AND GROUP TOGETHER ALL PIPE DROPS IN SALES AREA FROM ROOF TO LOW WALLS OR EQUIPMENT WITH OTHER MECHANICAL PIPES.
4. PAINT WIRING AND SUPPORTING METHODS FOR ALL SUSPENDED LUMINAIRES TO MATCH EXPOSED STRUCTURE.
5. CLEAN LUMINAIRES ASSOCIATED WITH NEW WORK THAT ARE TO REMAIN OR BE RELOCATED.
6. REPAIR OR REPLACE DAMAGED OR INOPERATIVE LUMINAIRES (NORMAL, EMERGENCY, AND EXIT).
7. EXISTING LIGHT FIXTURES TO BE CIRCUITED WITH NEW SWITCH AND OCCUPANCY SENSOR.

### ELECTRICAL POWER NOTES:

1. COORDINATE SCHEDULING WITH KROGER PROJECT MANGER TO PERMIT KROGER TO CONDUCT NORMAL BUSINESS OPERATIONS DURING CONSTRUCTION.
2. REUSE EXISTING BRANCH CIRCUITS MADE AVAILABLE BY DEMOLITION WHERE PRACTICAL UNLESS NOTED OTHERWISE. EXTEND EXISTING WIRING METHODS AS REQUIRED TO ACCOMMODATE NEW EQUIPMENT LOCATIONS. PROVIDE ADJUSTMENTS OR ADDITIONAL BRANCH CIRCUITS AS REQUIRED FROM NEAREST SUITABLE PANELBOARD. ROUTE NEW RACEWAYS BY MOST PRACTICAL CONCEALED MEANS AVAILABLE UNLESS NOTED OTHERWISE. DO NOT INSTALL RACEWAYS OR SAWCUT WITHOUT THE CONSENT OF THE KROGER PROJECT MANAGER.
3. UPDATE ALL LABELS AND DIRECTORIES FOR BRANCH CIRCUITS AFFECTED BY NEW CONSTRUCTION. HANDWRITTEN IDENTIFICATION SHALL NOT BE ACCEPTABLE.
4. COORDINATE AND GROUP TOGETHER ALL PIPE DROPS IN SALES AREA FROM ROOF TO LOWS OR EQUIPMENT WITH OTHER MECHANICAL PIPES.
5. COORDINATE EXACT DEVICE LOCATIONS WITH KROGER PROJECT MANAGER BEFORE ROUGH-IN.
6. CONDUIT AND WIRE SIZES INDICATED ARE MINIMUM REQUIREMENTS.
7. PROVIDE MINIMUM 3/4" C, 2#10-1#10 GND TO NEW OF SPARE 20/1 CB IN EXISTING NEAREST SUITABLE PANELBOARD.

### ELECTRICAL DEMO NOTES:

1. REMOVE OR RELOCATE EXISTING ELECTRICAL WORK AS REQUIRED TO ACCOMMODATE NEW WORK.
2. REMOVE AND RELOCATE EXISTING ELECTRICAL WORK FROM SURFACES OR WITHIN WALLS TO BE REMOVED TO NEAREST EXISTING WALL TO REMAIN OR NEW WALL AS REQUIRED. DO NOT LEAVE EXISTING ELECTRICAL WORK FREESTANDING IN AREAS INTENDED TO BE CLEAR SPACE. CONCEAL WHERE PRACTICABLE.
3. REMOVE AND RELOCATE EXISTING ELECTRICAL WORK ABOVE EXISTING SUSPENDED CEILINGS TO BE REMOVED. INSTALL AS TIGHT TO EXPOSED DECK AS PERMITTED BY CODE.
4. REMOVE EXISTING ABANDONED ELECTRICAL WORK ABOVE EXISTING SUSPENDED CEILINGS TO BE REMOVED.

issued for: <b>PERMITS</b>		10-01-2019
<b>PROPOSED GROCERY PICKUP FOR:</b>		
		
<b>STORE NO. D-447</b>		
23101 JOHN R ROAD HAZEL PARK, MI 48030		
<b>THE KROGER CO. OF MICHIGAN</b>		
 <b>jeffery a. scott architects p.c.</b>		
32316 grand river ave. suite 200 farmington, michigan 48336-3261 (248) 476-8800 fax (248) 476-8833		
<b>ELECTRICAL PLAN AND NOTES</b>		
project no.	sheet no.	
<b>19030.05</b>	<b>E13</b>	